


Ascendra Aminos



**COC#** 145935  
**Lab #** 214803  
**Date Rec'd** 9/28/2026  
**Report Issued** 10/12/2026

## Certificate of Analysis



**Project**  
**Compound** GHK-Cu  
**Label Claim** 100 mg  
**Batch/Lot**


| <u>Analyte</u>                   | <u>Result</u> | <u>Units</u> | <u>LOQ</u> | <u>% of Label</u> | <u>Method</u> | <u>Date</u> | <u>CAS</u> |
|----------------------------------|---------------|--------------|------------|-------------------|---------------|-------------|------------|
| <b>Peptides &amp; Bioactives</b> |               |              |            |                   |               |             |            |
| Chromatographic purity           | 99.5          | %            | 1          |                   | HPLC-UV/MS    | 10/3/2026   |            |
| GHK-Cu                           | 91.7          | mg           | .1         | 91.7              | HPLC-UV-MS    | 10/3/2026   | 89030-95-5 |
| Mass Spectral Match              | ID Confirmed  |              |            |                   | HPLC-UV-MS    | 10/3/2026   |            |

The data presented are from the analysis of the sample shown and meet Krause Analytical internal quality assurance criteria unless otherwise flagged.  
 Data is not for regulatory compliance nor diagnostic use.  
 Methods shown reference current Krause Analytical SOPs  
 ND - Not detected LOQ - limit of quantification  
 OCH - above calibrated range OCL - below calibrated range  
 All values reported on a per vial basis unless otherwise noted  
 Copyright © 2026 Krause Analytical LLC. All rights reserved.


Respectfully submitted,

Mark C. Krause  
 Laboratory Director

\*\*\*\*\*  
CHROMATOGRAM  
\*\*\*\*\*

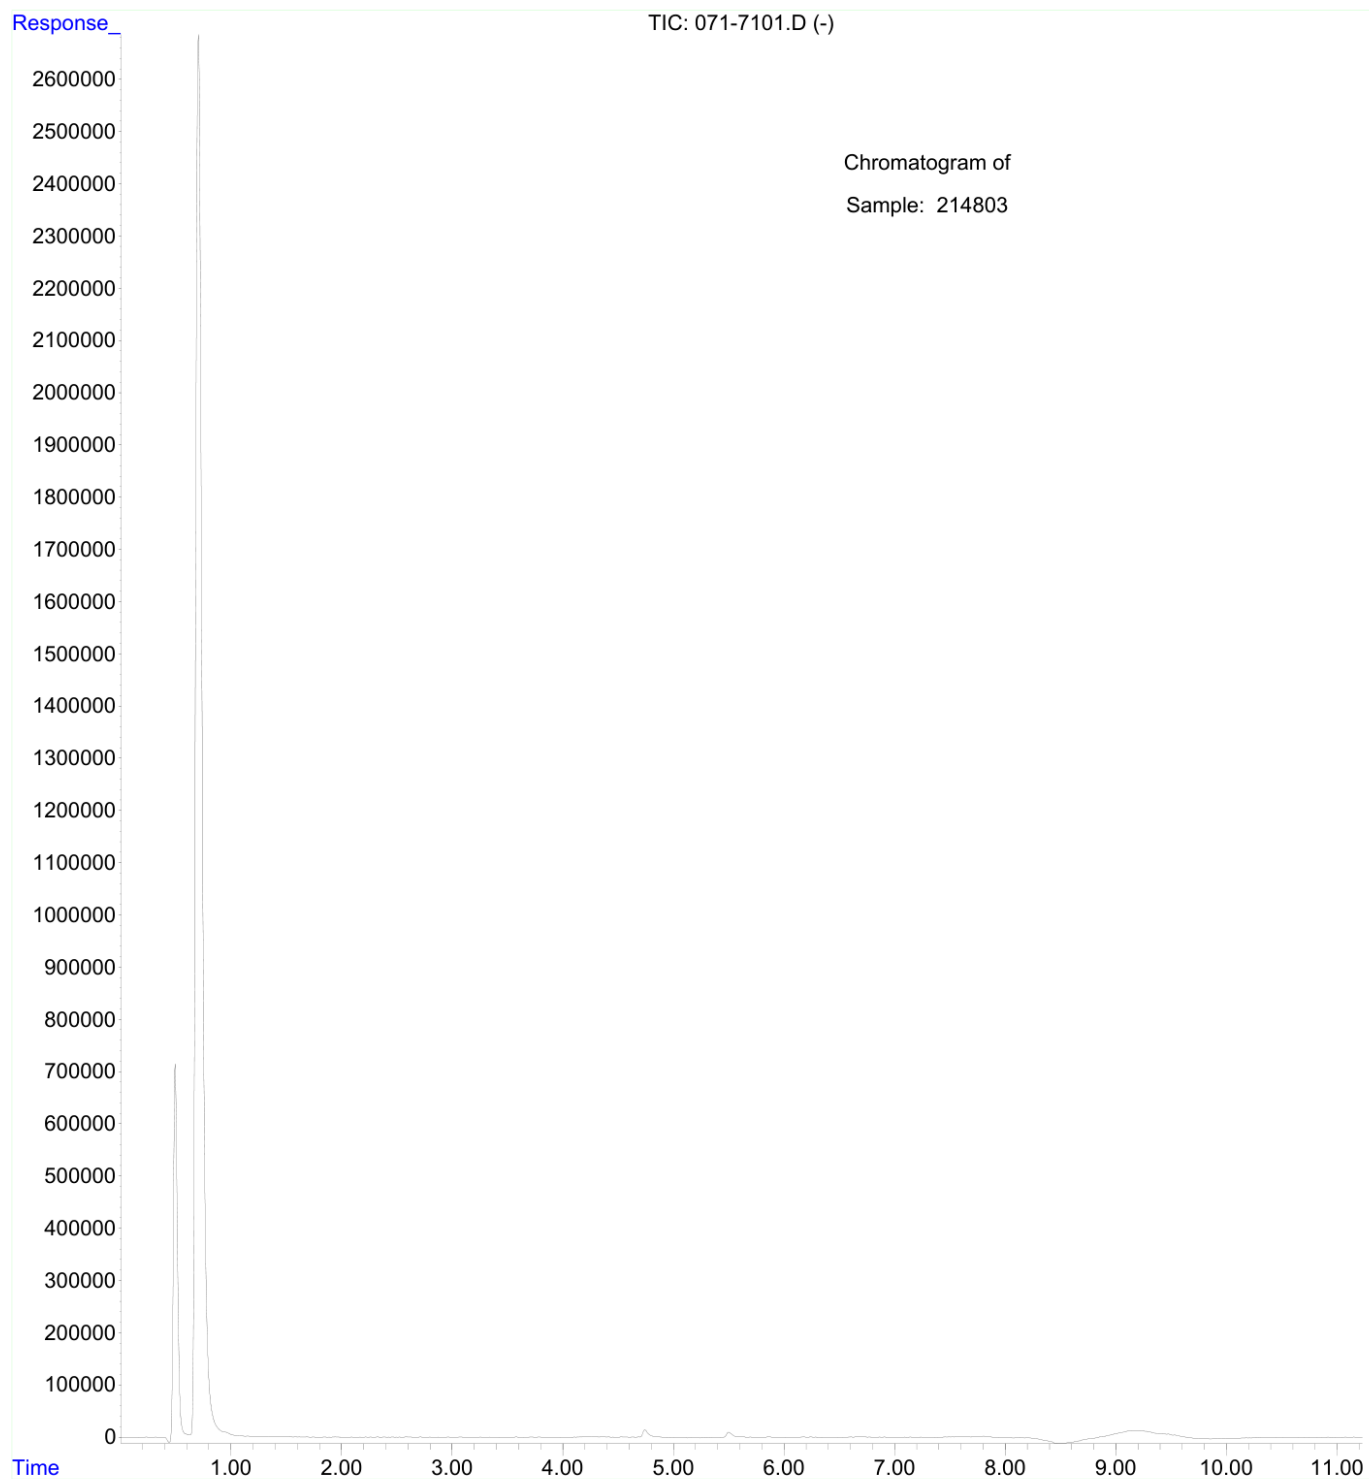

214803 35 (0.647) Cm (30:47)

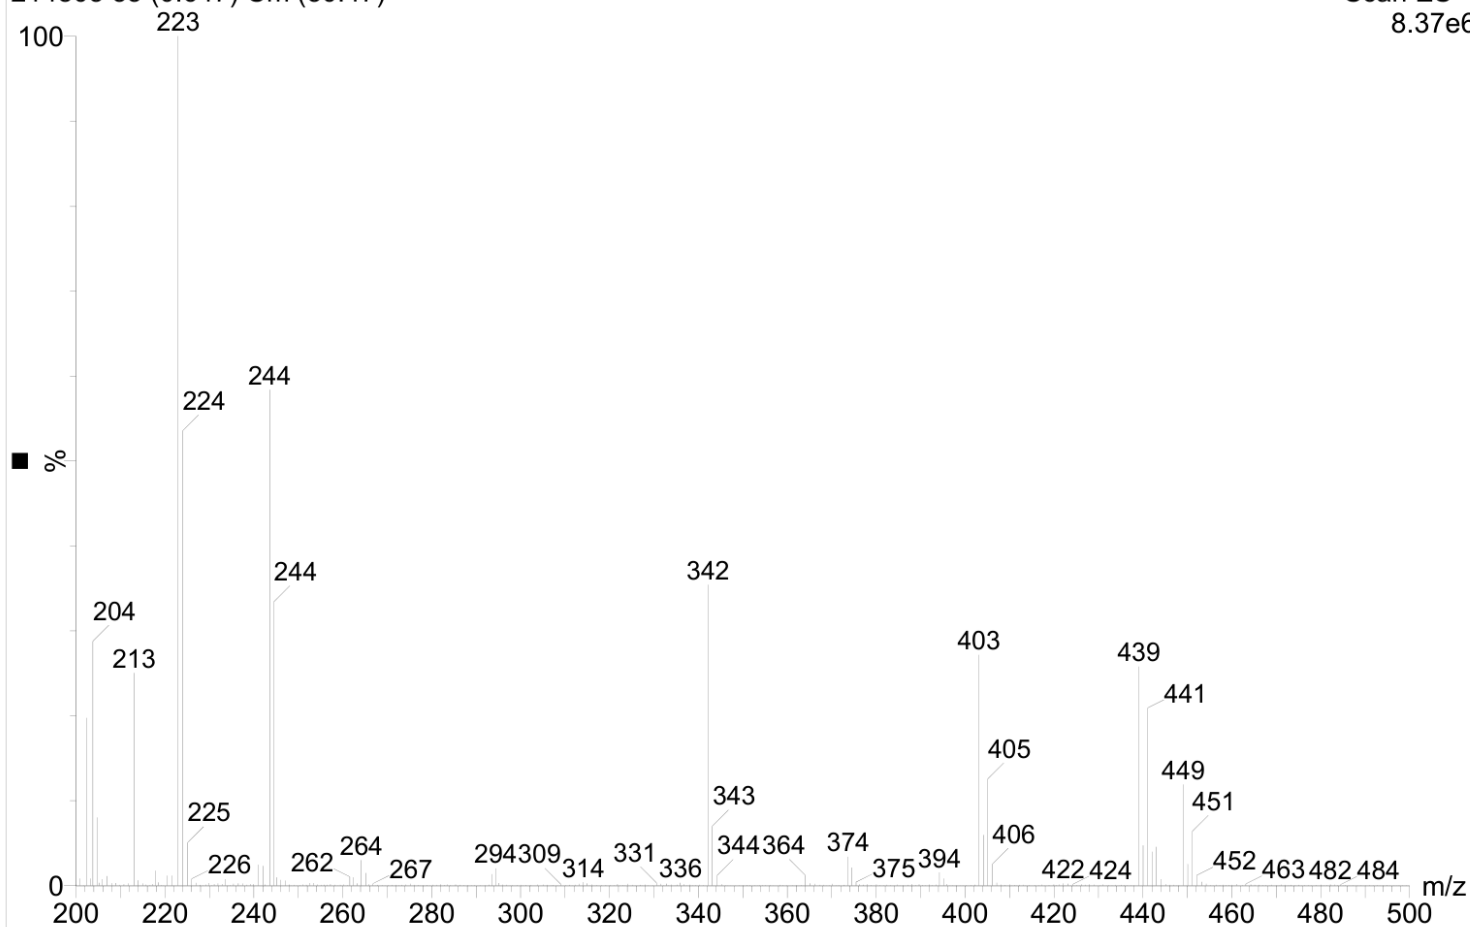Scan ES+  
8.37e6

GHK-Cu 35 (0.647)

Scan ES+  
8.37e6