


Ascendra Aminos



COC# 145935
Lab # 214804
Date Rec'd 9/28/2026
Report Issued 10/15/2026

Certificate of Analysis



Project
Compound GLOW
Label Claim 70 mg
Batch/Lot

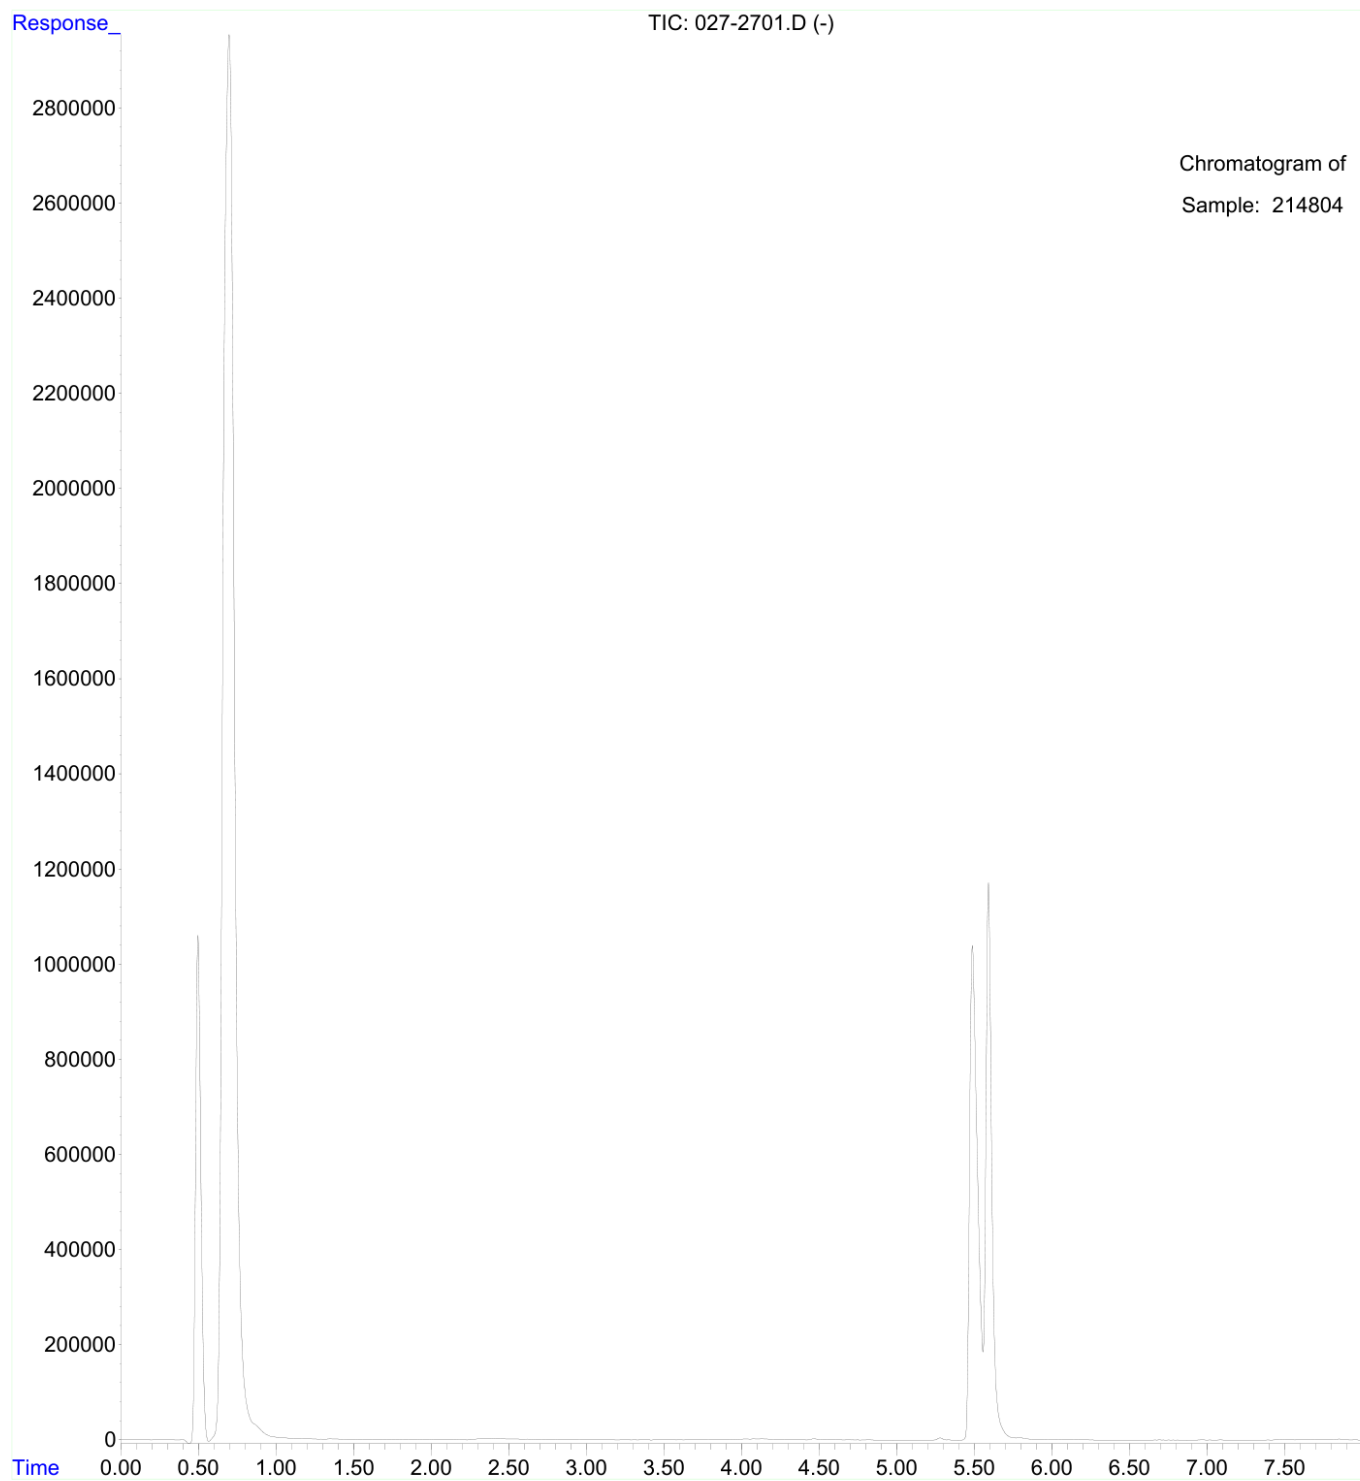
<u>Analyte</u>	<u>Result</u>	<u>Units</u>	<u>LOQ</u>	<u>% of Label</u>	<u>Method</u>	<u>Date</u>	<u>CAS</u>
Peptides & Bioactives							
Chromatographic purity	>99.9	%	1		HPLC-UV/MS	10/2/2026	
BPC-157	9.58	mg	.1	95.8	HPLC-UV-MS	10/2/2026	137525-51-0
Mass Spectral Match	ID Confirmed				HPLC-UV-MS	10/2/2026	
GHK-Cu	52.1	mg	.1	104.2	HPLC-UV-MS	10/2/2026	89030-95-5
Mass Spectral Match	ID Confirmed				HPLC-UV-MS	10/2/2026	
Thymosin β 4	10.2	mg	.1	102.3	HPLC-UV-MS	10/2/2026	77591-33-4
Mass Spectral Match	ID Confirmed				HPLC-UV-MS	10/2/2026	

The data presented are from the analysis of the sample shown and meet Krause Analytical internal quality assurance criteria unless otherwise flagged.
 Data is not for regulatory compliance nor diagnostic use.
 Methods shown reference current Krause Analytical SOPs
 ND - Not detected LOQ - limit of quantification
 OCH - above calibrated range OCL - below calibrated range
 All values reported on a per vial basis unless otherwise noted
 Copyright © 2026 Krause Analytical LLC. All rights reserved.

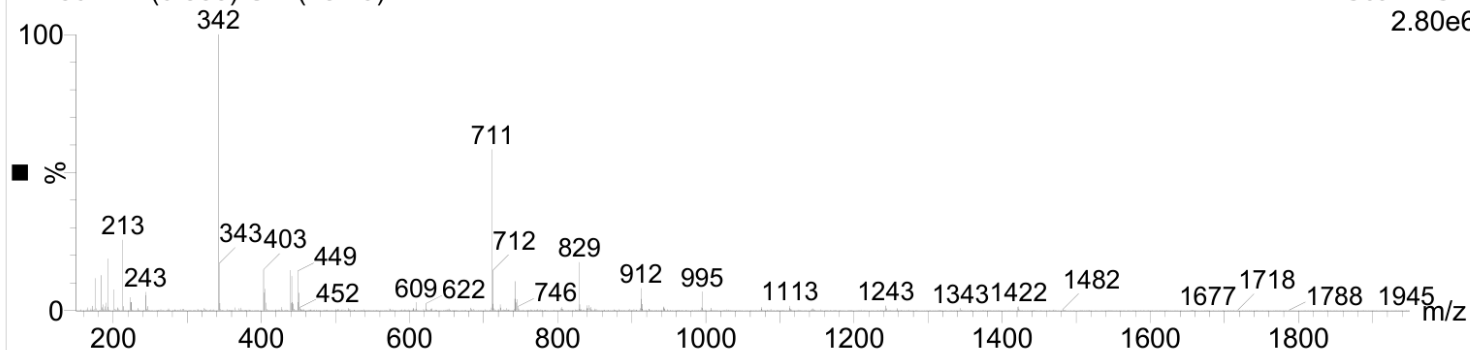
Respectfully submitted,

Mark C. Krause
 Laboratory Director

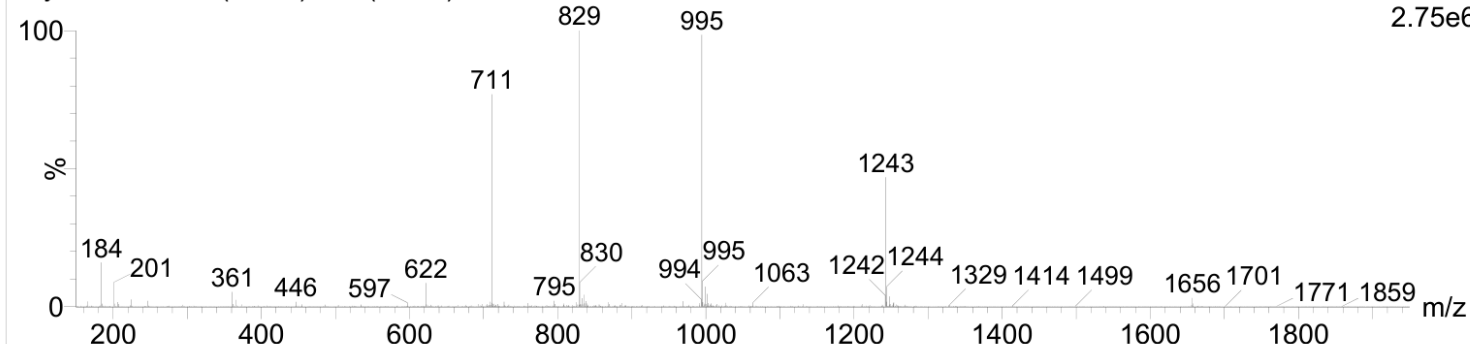
CHROMATOGRAM



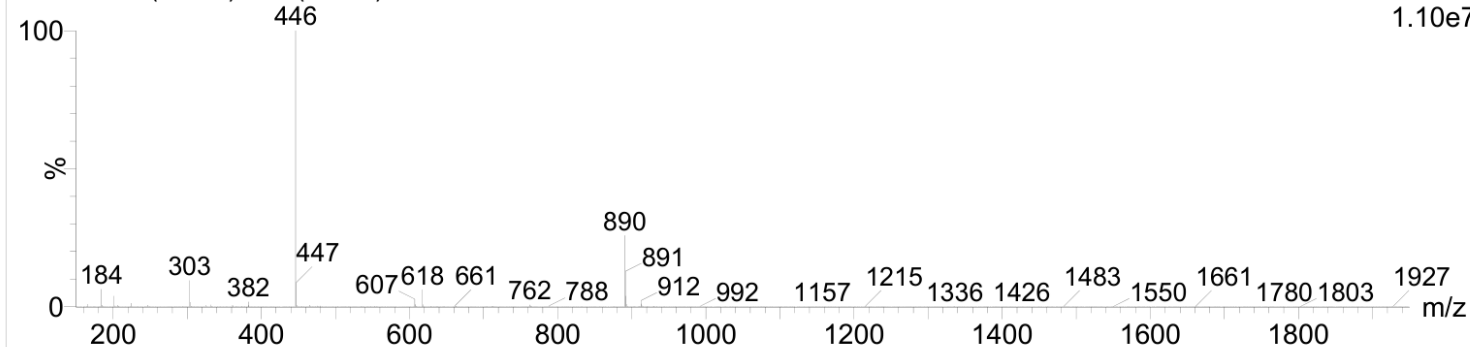
214804 21 (0.388) Cm (18:29)

Scan ES+
2.80e6

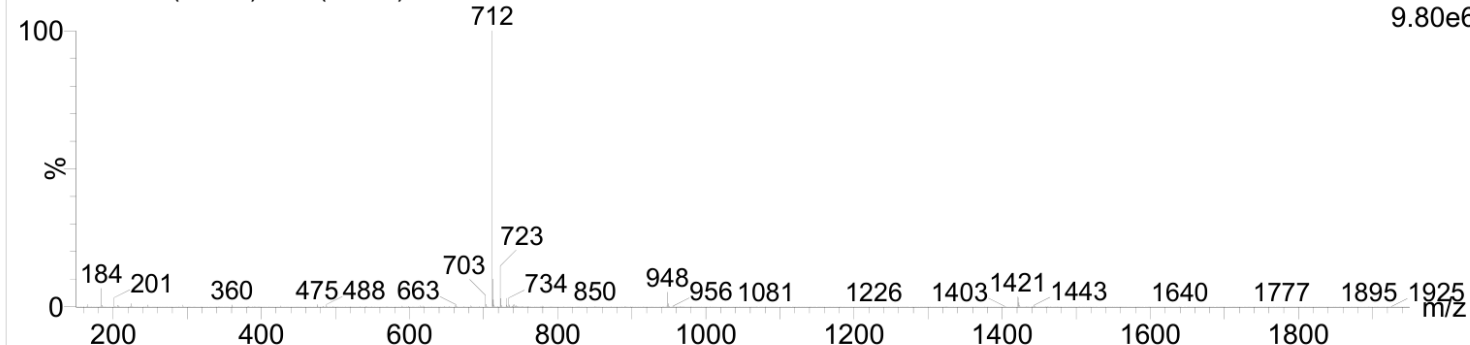
Thymosin B4 22 (0.407) Cm (16:35)

Scan ES+
2.75e6

TB-500 20 (0.370) Cm (17:35)

Scan ES+
1.10e7

BPC-157 23 (0.425) Cm (16:36)

Scan ES+
9.80e6

GHK-Cu 21 (0.388) Cm (18:37)

Scan ES+
2.76e6